


Stack Emissions

All sulphur dioxide and nitrogen dioxide emissions were below the permitted levels except for Unit 2's nitrogen dioxide emissions which exceeded the EIA permitted level temporarily but did not exceed the Thai standard as a result of combustion tuning of Unit 2. Fortunately, the data of unit 2 wasn't sent to local authority yet. Opacity of both units is being carefully monitored. A provision correlation curve for the CEMS was installed and being monitored. However, all values were still below the Thai legal limit and will not impact TSP and PM10 concentrations in ambient air at the 4 AQMS stations.

● Sulfur Dioxide (SO₂) : May 2007

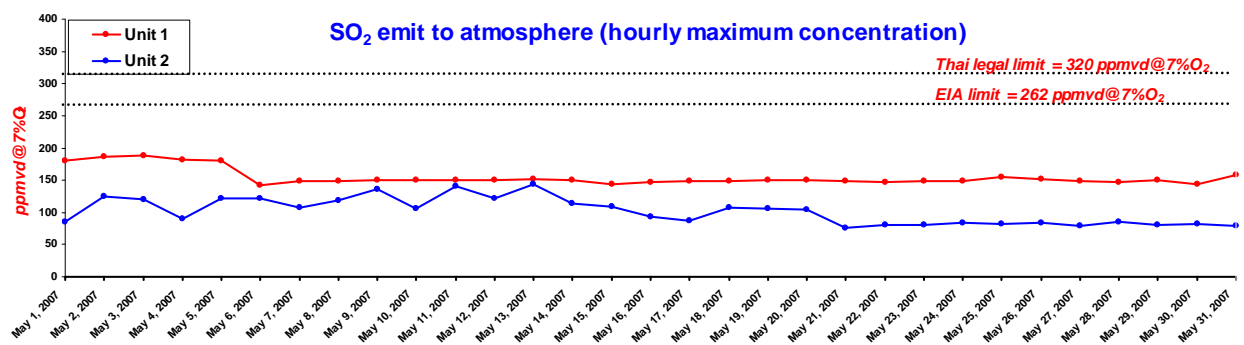

● Nitrogen Oxides (NO_x) : May 2007

